
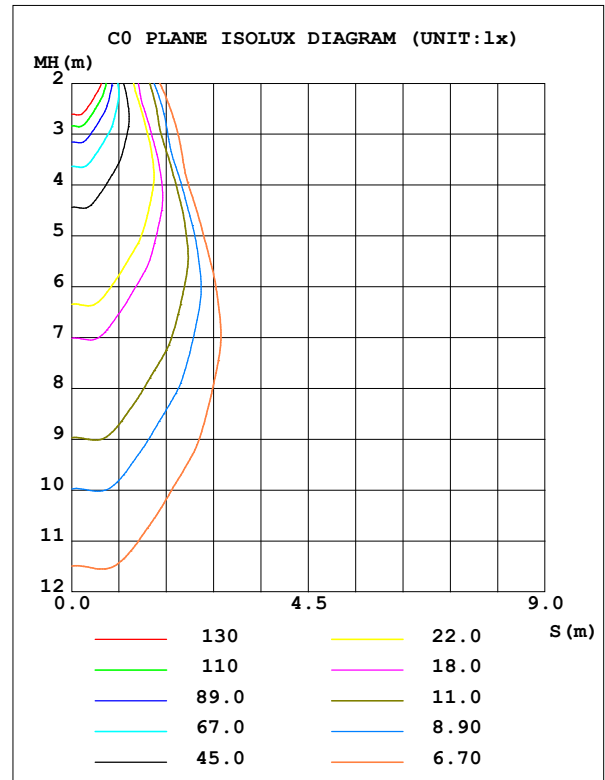


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 72.64 lm/W
MODEL		I <sub>max</sub> (cd)	897.0	S/MH (C0/180)		0.65
NOMINAL POWER (W)		LOR (%)	100.0	S/MH (C90/270)		0.64
RATED VOLTAGE (V)	230V	TOTAL FLUX (lm)	472.18	η UP,DN (C0-180)		0.0,50.5
NOMINAL FLUX (lm)	472.184	CIE CLASS	DIRECT	η UP,DN (C180-360)		0.0,49.5
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM		0.50
TEST VOLTAGE (V)		η down (%)	100.0	CIBSE SHR MAX		0.65

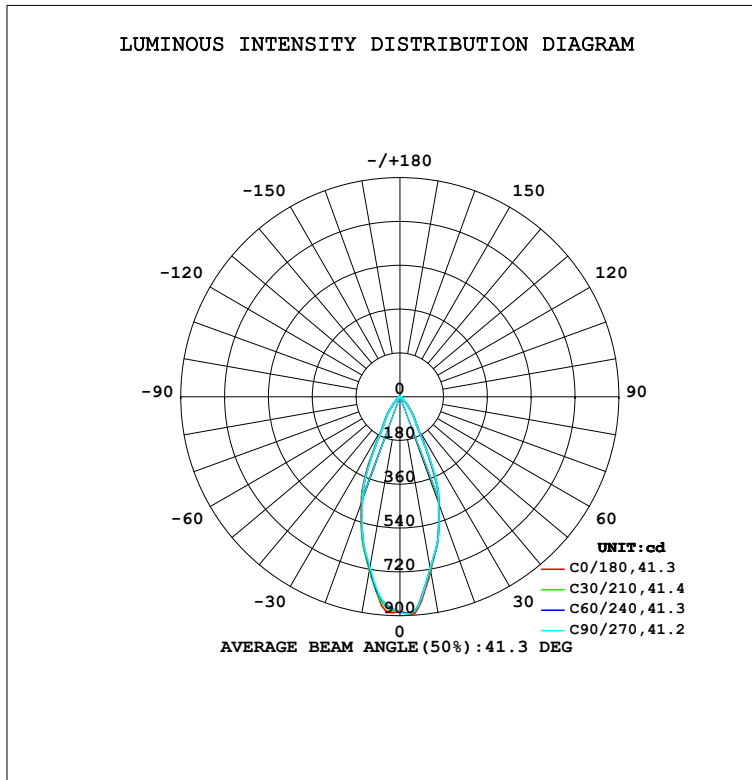

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_v1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

### ZONAL FLUX DIAGRAM

#### ZONAL FLUX DIAGRAM:


$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum,lamp
10	727.2	719.1	715.9	717.7	722.9	720.0	712.9	718.4	0- 10	76.77	76.77	16.3,16.3
20	465.5	469.2	468.3	467.6	465.2	455.7	452.3	460.1	10- 20	164.7	241.5	51.1,51.1
30	143.4	144.2	144.1	144.0	143.2	138.9	135.6	139.8	20- 30	134.1	375.6	79.5,79.5
40	59.16	58.20	55.35	53.55	54.21	54.70	55.49	57.53	30- 40	59.28	434.9	92.1,92.1
50	12.88	12.64	12.32	12.35	12.76	12.47	12.62	12.88	40- 50	22.34	457.2	96.8,96.8
60	7.088	6.868	6.880	6.947	7.144	7.065	6.847	6.885	50- 60	8.186	465.4	98.6,98.6
70	2.895	2.733	2.734	2.806	2.837	2.897	2.810	2.755	60- 70	4.800	470.2	99.6,99.6
80	0.7585	0.7076	0.7142	0.7388	0.7225	0.7497	0.7212	0.7047	70- 80	1.693	471.9	99.9,99.9
90	0	0	0	0	0	0	0	0	80- 90	0.3009	472.2	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_v1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

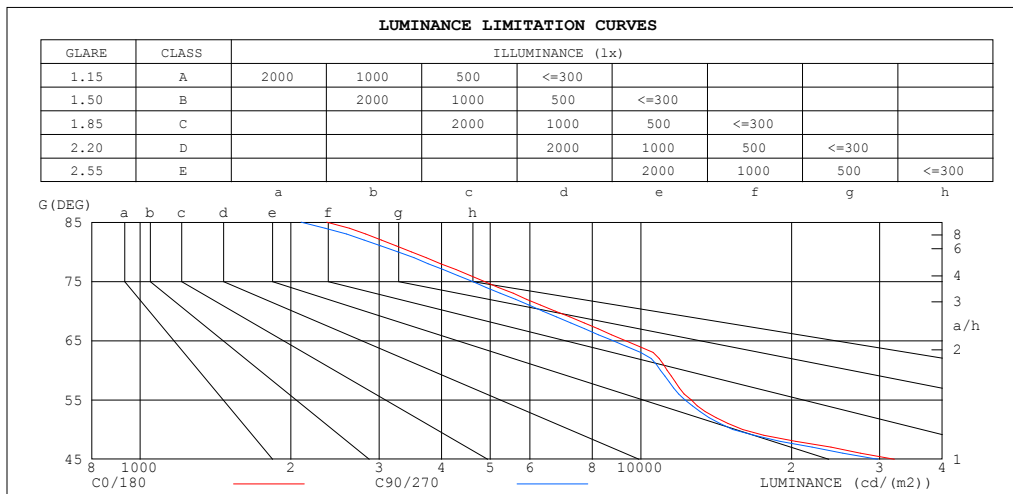

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	2360	2095
80	3481	3274
75	4865	4604
70	6745	6365
65	9303	8791
60	11296	10953
55	12606	12249
50	15973	15258
45	32118	29722


C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jason  
 Test Date: 21 October 2020

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
 Humidity: 65.0%  
 Test Distance: 3.160m [K=1.0000]  
 Remarks:

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

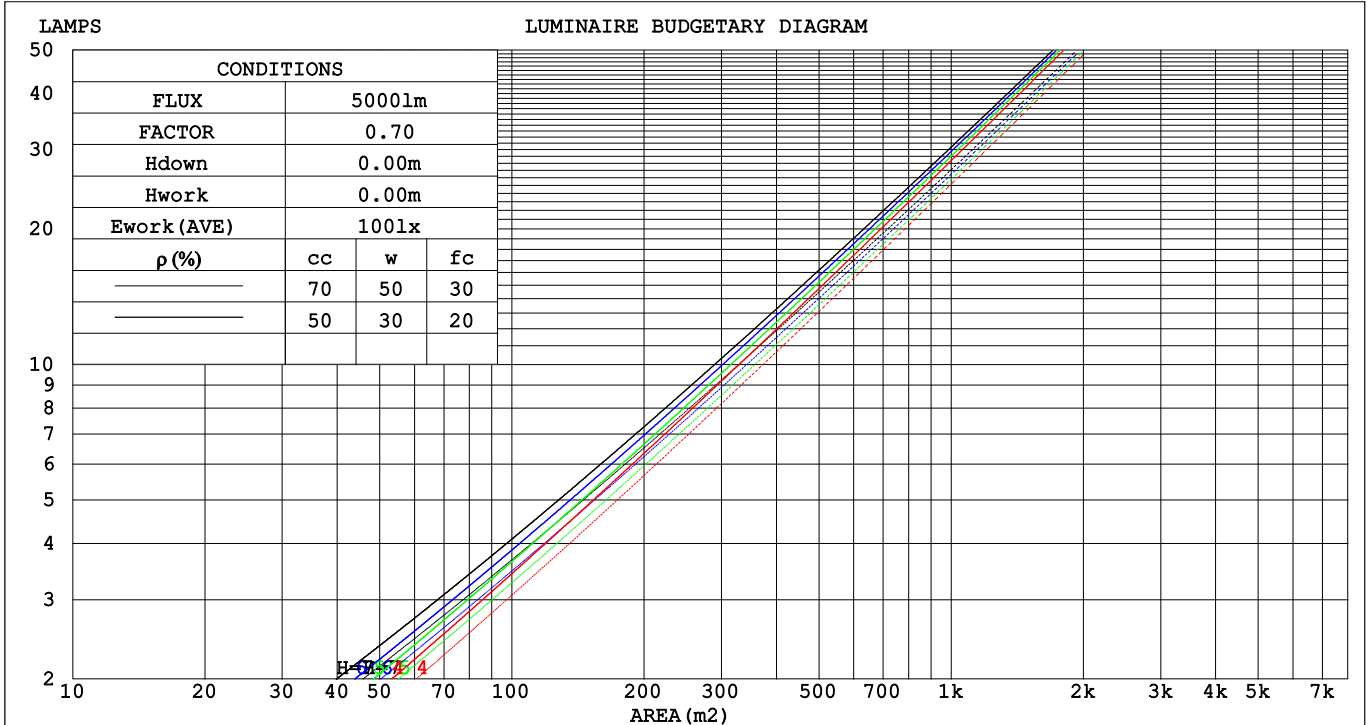

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

## WEC AND CCEC

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.170	.097	.031	.164	.093	.030	.151	.087	.028	.140	.081	.026	.129	.075	.024	
2.0	.162	.089	.027	.156	.086	.027	.146	.081	.025	.136	.076	.024	.127	.072	.023	
3.0	.153	.082	.024	.149	.080	.024	.140	.076	.023	.131	.072	.022	.124	.068	.021	
4.0	.145	.075	.022	.141	.074	.022	.133	.071	.021	.126	.068	.020	.120	.065	.020	
5.0	.138	.070	.020	.134	.069	.020	.128	.066	.020	.121	.064	.019	.116	.062	.019	
6.0	.131	.066	.019	.128	.065	.019	.122	.063	.018	.117	.061	.018	.112	.059	.017	
7.0	.125	.062	.018	.122	.061	.017	.117	.059	.017	.112	.058	.017	.108	.056	.016	
8.0	.119	.058	.016	.117	.058	.016	.112	.056	.016	.108	.055	.016	.104	.053	.016	
9.0	.114	.055	.015	.112	.055	.015	.108	.053	.015	.104	.052	.015	.100	.051	.015	
10.0	.109	.052	.015	.107	.052	.014	.104	.051	.014	.100	.050	.014	.097	.049	.014	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.087	.057	.054	.050	.018	.017	.016	
2.0	.155	.133	.114	.133	.114	.098	.091	.079	.069	.052	.046	.040	.017	.015	.013	
3.0	.142	.114	.091	.122	.098	.079	.084	.068	.055	.048	.040	.033	.016	.013	.011	
4.0	.131	.099	.074	.113	.085	.064	.077	.059	.045	.045	.035	.027	.014	.011	.009	
5.0	.122	.087	.061	.105	.075	.053	.072	.053	.037	.042	.031	.022	.013	.010	.007	
6.0	.114	.077	.051	.098	.067	.044	.068	.047	.031	.039	.028	.019	.013	.009	.006	
7.0	.107	.070	.043	.092	.060	.038	.064	.042	.027	.037	.025	.016	.012	.008	.005	
8.0	.102	.063	.037	.087	.055	.032	.060	.039	.023	.035	.023	.014	.011	.007	.005	
9.0	.096	.058	.032	.083	.050	.028	.057	.035	.020	.033	.021	.012	.011	.007	.004	
10.0	.092	.054	.028	.079	.047	.025	.055	.033	.018	.032	.019	.010	.010	.006	.003	

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

### UGR(Unified Glare Rating) Table

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm											
NAME: SLDL280F-4030P-BGDD09					TYPE:			WEIGHT:			
SPEC.:					DIM.:			SERIAL No.:			
MFR.: Switch Lighting					SUR.:			Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	21.5	22.4	21.7	22.5	22.7	21.4	22.3	21.6	22.4	22.6
	3H	21.6	22.4	21.8	22.6	22.8	21.4	22.3	21.7	22.5	22.7
	4H	21.6	22.3	21.8	22.5	22.8	21.4	22.2	21.7	22.4	22.6
	6H	21.5	22.2	21.8	22.5	22.7	21.4	22.1	21.7	22.3	22.6
	8H	21.5	22.2	21.8	22.4	22.7	21.3	22.0	21.7	22.3	22.6
	12H	21.4	22.1	21.7	22.4	22.6	21.3	22.0	21.6	22.2	22.5
4H	2H	21.4	22.2	21.7	22.4	22.6	21.3	22.1	21.6	22.3	22.5
	3H	21.5	22.2	21.8	22.5	22.7	21.4	22.1	21.7	22.4	22.6
	4H	21.5	22.1	21.9	22.4	22.7	21.4	22.0	21.8	22.3	22.6
	6H	21.5	22.0	21.9	22.4	22.7	21.4	21.9	21.8	22.3	22.6
	8H	21.5	22.0	21.9	22.3	22.7	21.4	21.9	21.7	22.2	22.6
	12H	21.4	21.9	21.8	22.3	22.6	21.3	21.8	21.7	22.1	22.5
8H	4H	21.4	21.9	21.8	22.3	22.6	21.3	21.8	21.7	22.2	22.5
	6H	21.4	21.8	21.8	22.2	22.6	21.3	21.7	21.7	22.1	22.5
	8H	21.4	21.7	21.8	22.2	22.6	21.3	21.6	21.7	22.1	22.5
	12H	21.4	21.7	21.8	22.1	22.6	21.2	21.6	21.7	22.0	22.5
12H	4H	21.4	21.8	21.8	22.2	22.6	21.3	21.7	21.7	22.1	22.5
	6H	21.4	21.7	21.8	22.1	22.6	21.3	21.6	21.7	22.0	22.5
	8H	21.3	21.7	21.8	22.1	22.6	21.2	21.5	21.7	22.0	22.5
Variations with the observer position at spacings:											
S = 1.0H		+ 2.2 / - 4.0					+ 2.1 / - 3.9				
1.5H		+ 4.0 / - 3.6					+ 4.0 / - 3.4				
2.0H		+ 3.8 / - 1.5					+ 3.4 / - 1.3				

CIE Pub.117, 472.2 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -2.6)

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

### UTILIZATION FACTORS TABLE

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	80	76	86	80	76	85	80	76	72
0.80	94	88	84	93	88	84	92	87	84	80
1.00	99	93	89	98	93	89	96	92	88	84
1.25	103	97	94	102	97	94	100	96	93	88
1.50	106	101	97	104	100	97	102	98	96	91
2.00	108	104	101	107	103	100	104	101	98	93
2.50	110	106	103	108	105	102	105	102	100	94
3.00	112	108	105	110	107	104	106	104	102	96
4.00	114	111	109	112	109	107	108	106	105	97
5.00	115	113	111	113	111	109	109	107	106	98
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

# ISOCANDELA DIAGRAM

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

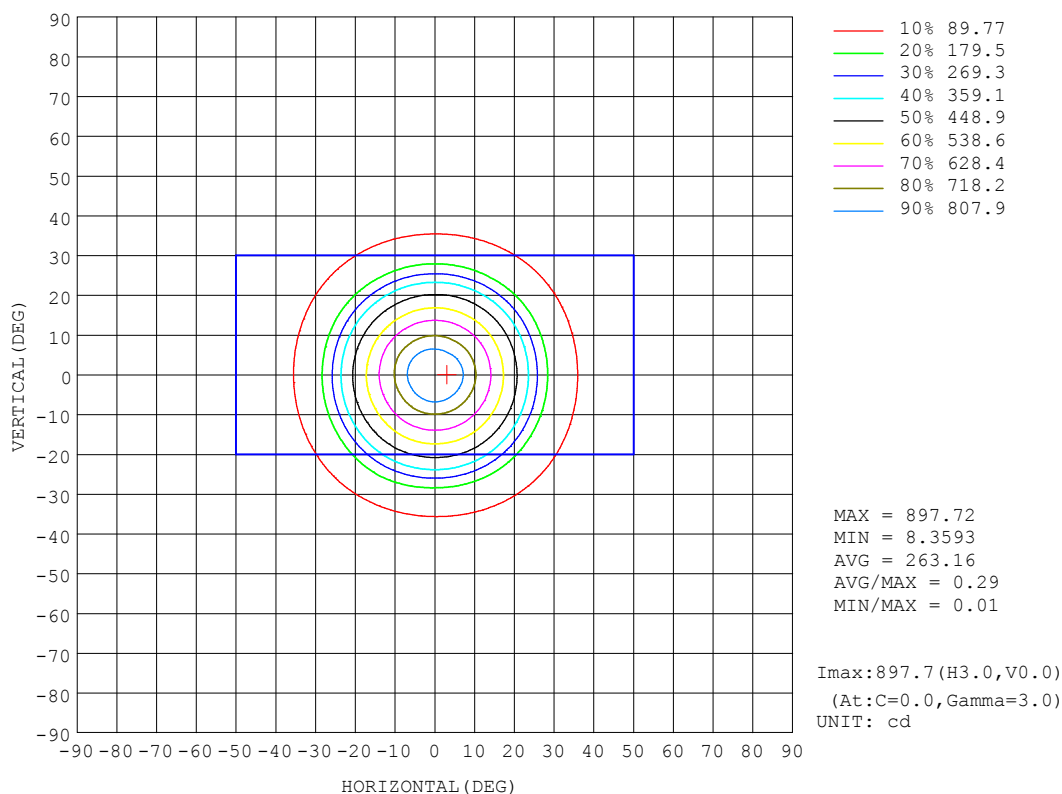


C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_v1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:



**AAI Figure**

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

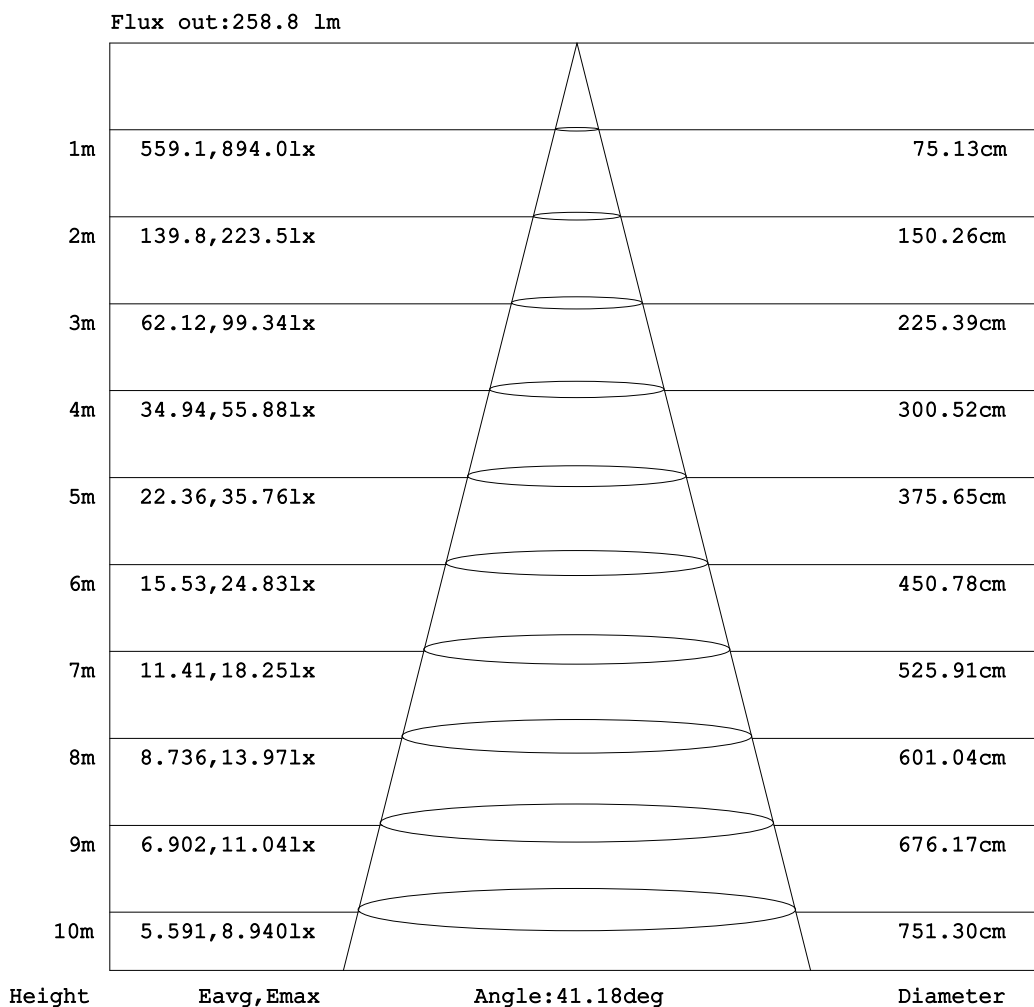


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jason  
 Test Date:21 October 2020

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
 Humidity:65.0%  
 Test Distance:3.160m [K=1.0000]  
 Remarks:

ISOLUX DIAGRAM

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:

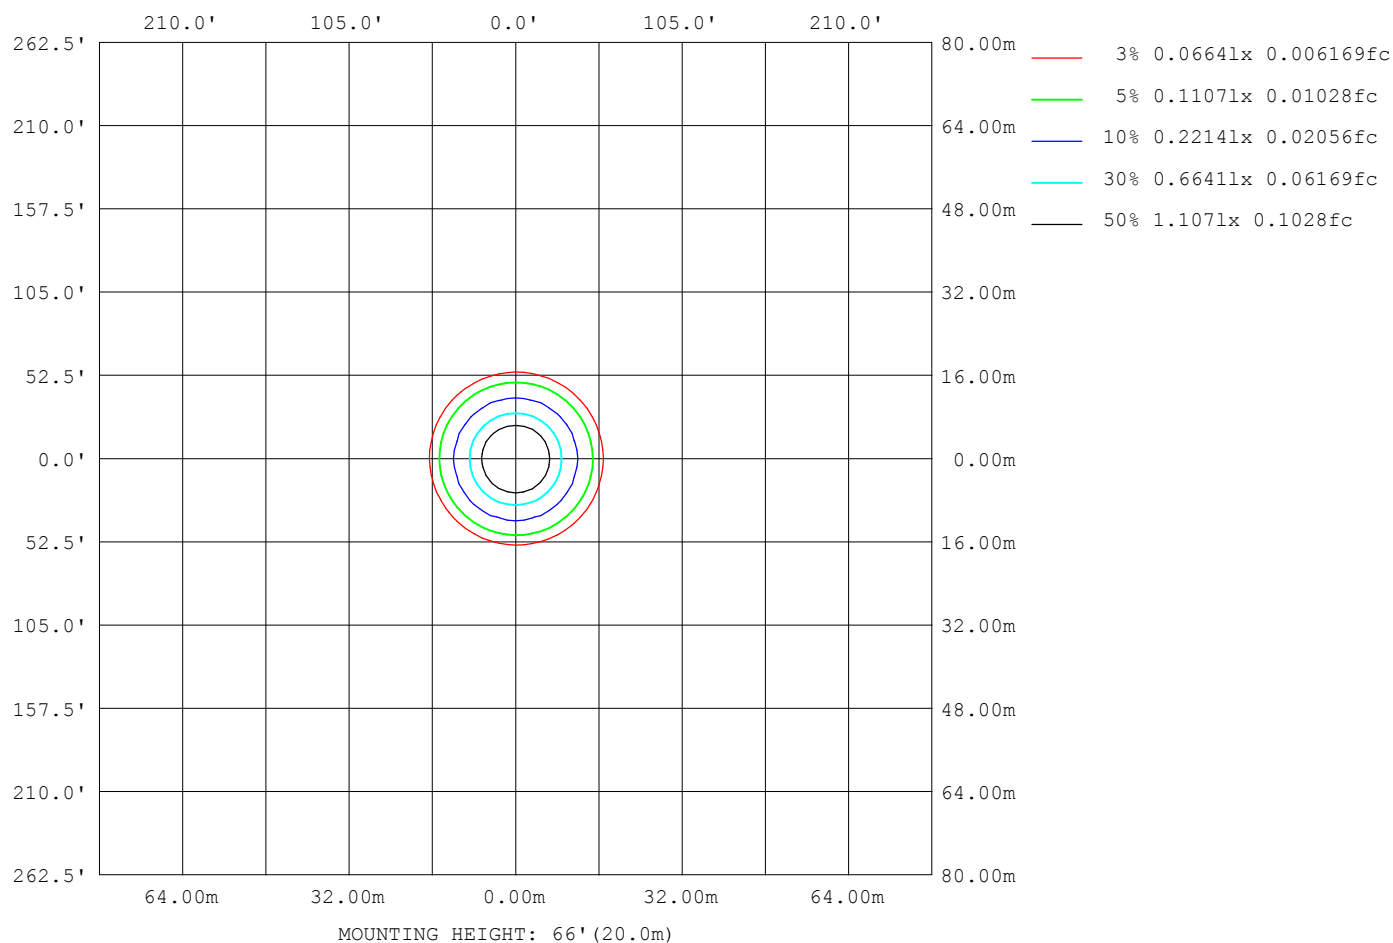

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

### LED Avg.L Report

Test:U:230.00V I:0.0300A P:6.5000W PF:0.9580 Freq:50.00Hz Lamp Flux:472.184x1 lm		
NAME: SLDL280F-4030P-BGDD09	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Switch Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9259
L_0~180 (75) av	4785
L_0~180 (85) av	2250
L_90~270 (65) av	8915
L_90~270 (75) av	4641
L_90~270 (85) av	2185
L_45 (65) av	9022
L_45 (75) av	4689
L_45 (85) av	2205

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jason  
Test Date:21 October 2020

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity:65.0%  
Test Distance:3.160m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

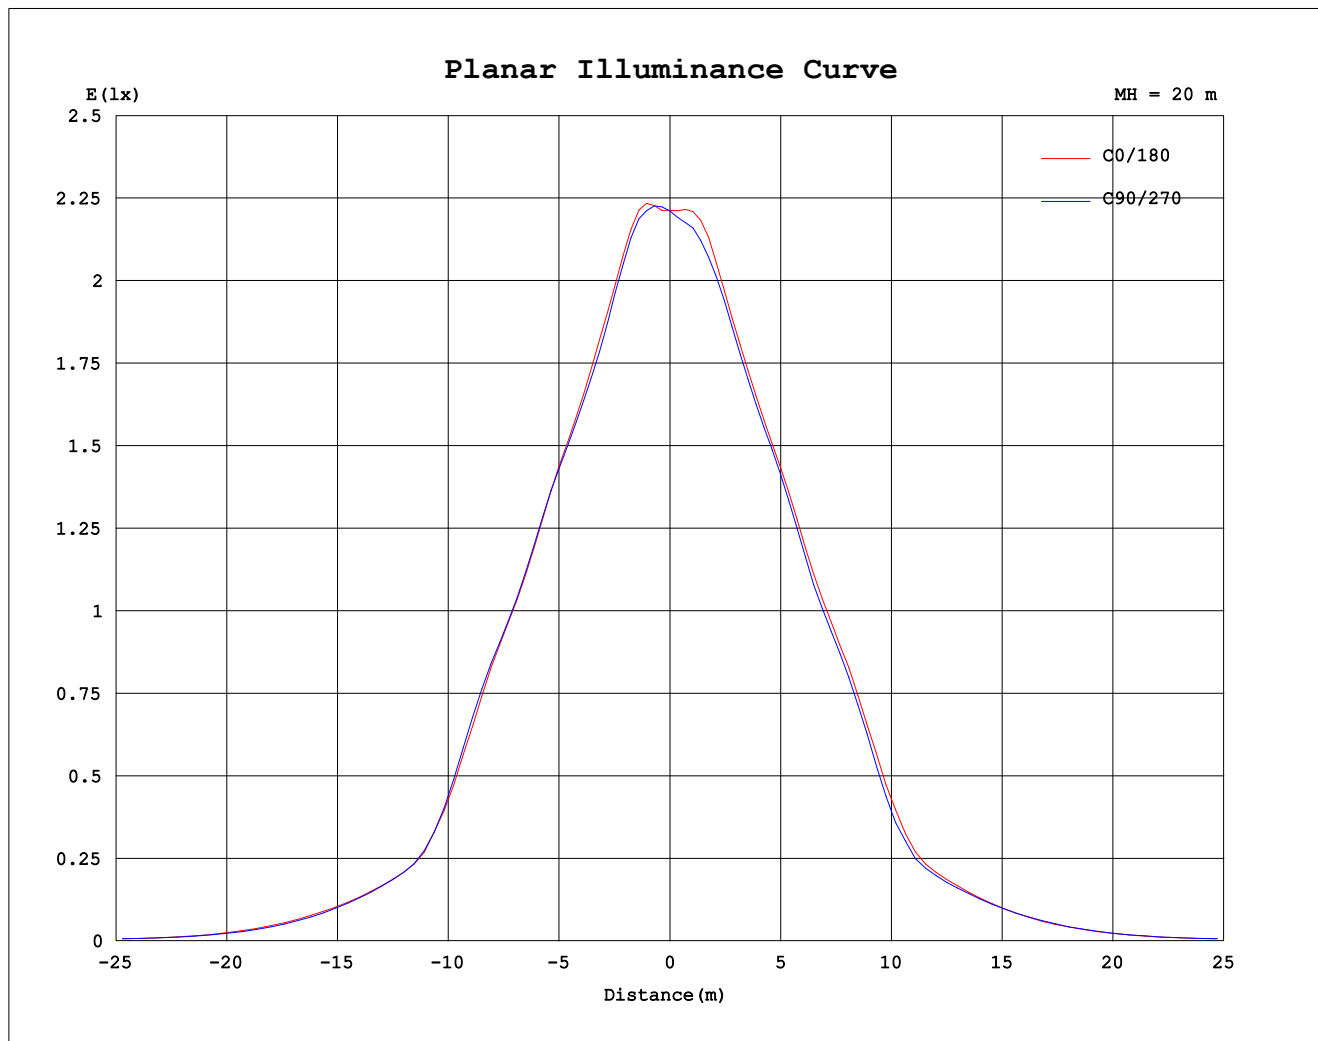

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: Jason  
Test Date: 21 October 2020

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-i300\_V1 SYSTEM V2.0.401  
Humidity: 65.0%  
Test Distance: 3.160m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-i300_V1 SYSTEM V2.0.401
Humidity:65.0%
Test Distance:3.160m [K=1.0000]
Remarks:

```